


SECTION

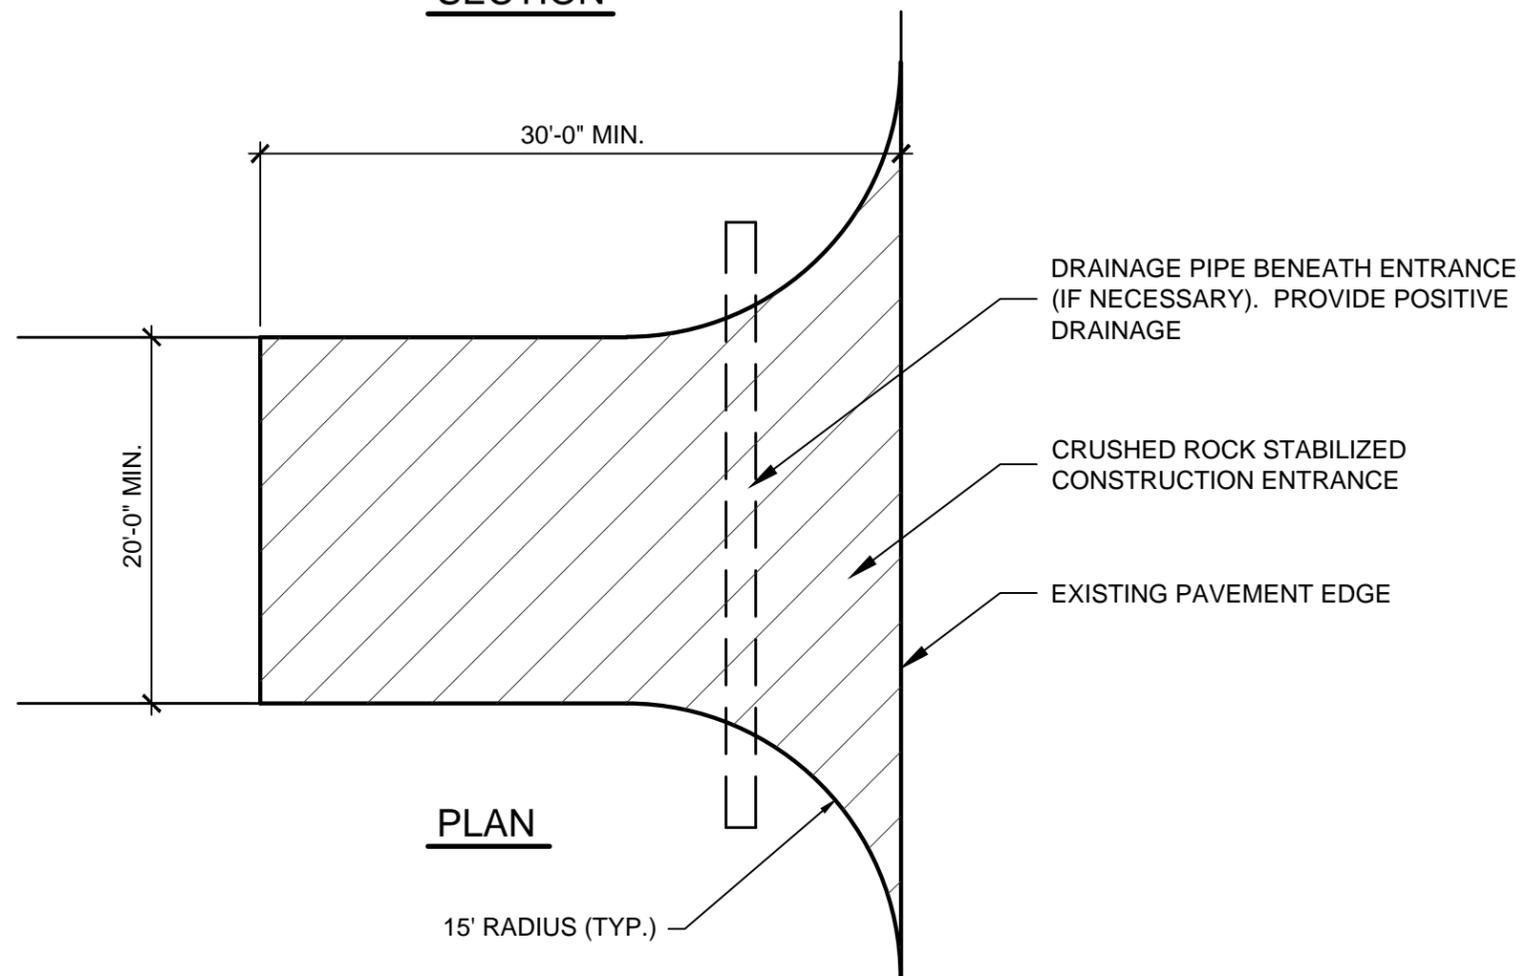

PLAN

GENERAL NOTES:

1. CRUSHED STONE FOR CONSTRUCTION ENTRANCE SHALL BE 2"- 3" AT GREATEST DIMENSION AND SHALL BE INSTALLED TO A COMPACTED DEPTH OF SIX INCHES.
2. FILTER FABRIC IS TO BE MIRAFI 100X OR EQUAL
3. IF CONSTRUCTION ENTRANCE CROSSES A DRAINAGE DITCH, SWALE, ETC., A DRAINAGE PIPE SHALL BE INSTALLED WITH A MIN. 12" OF COVER OVER CRUSHED STONE.
4. REMOVE AND DISPOSE OF OFF-SITE STABILIZED CONSTRUCTION ENTRANCE WHEN PROJECT IS COMPLETE. REPAIR ALL DAMAMGE INCLUDING RE-GRADING AND RE-GRASSING.

Standard Construction Details

for
City of Dallas
Park and Recreation Department

Typical Construction Details
PAVEMENT &
PARKING DETAILS

**STABILIZED
CONSTRUCTION
ENTRANCE
PLAN**

issue date

revisions