






scale:  
dsnd:  
drawn:  
approved:

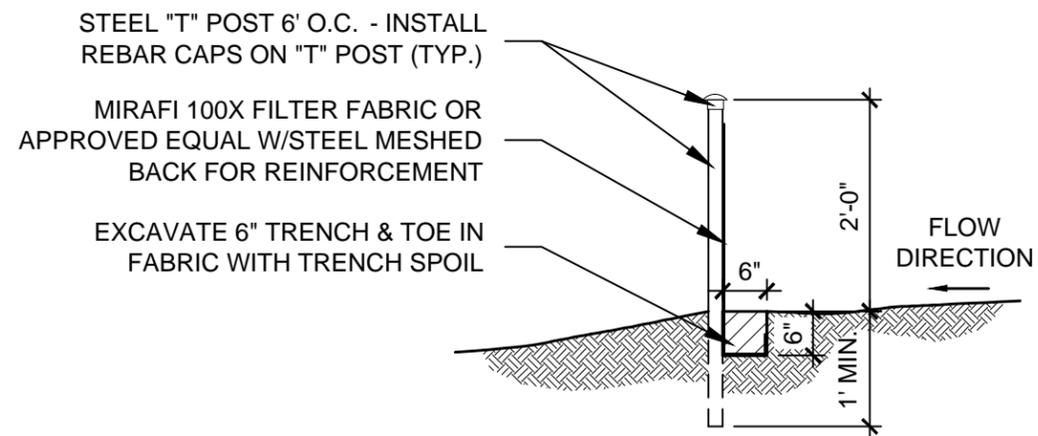

**SECTION**

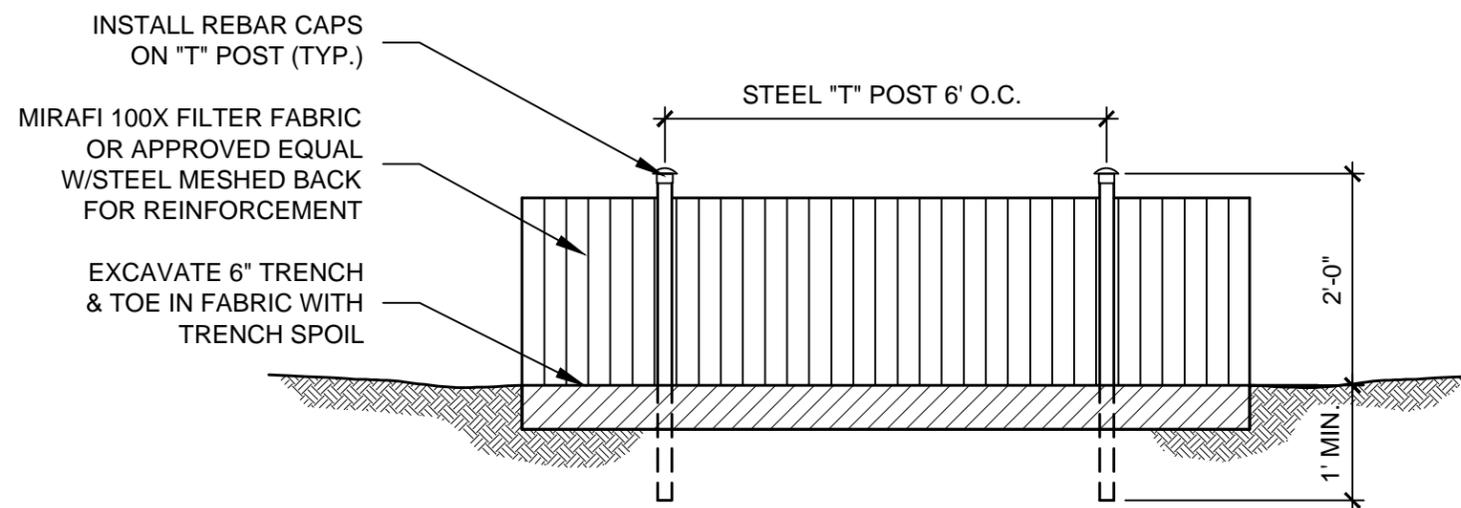

**ELEVATION**

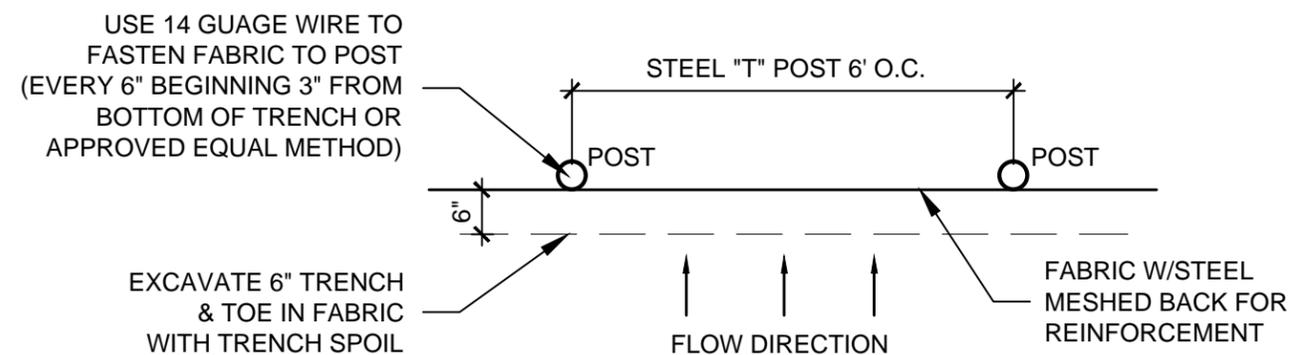

**PLAN**

**SILT FENCE NOTES:**

1. STEEL POSTS WHICH SUPPORT THE SILT FENCE SHALL BE INSTALLED ON A SLIGHT ANGLE TOWARD THE ANTICIPATED RUNOFF SOURCE.
2. THE TOE OF THE SILT FENCE SHALL BE TRENCHED IN WITH A SPADE OR MECHANICAL TRENCHER, SO THAT THE DOWN SLOPE FACE OF THE TRENCH IS FLAT AND PERPENDICULAR TO THE LINE OF FLOW.
3. THE TRENCH SHOULD BE A MINIMUM OF SIX INCHES DEEP AND SIX INCHES WIDE TO ALLOW FOR THE SILT FENCE TO BE LAID IN THE GROUND AND BACKFILLED.
4. SILT FENCE SHOULD BE SECURELY FASTENED TO EACH SUPPORT POST.
5. INSPECTION SHALL BE FREQUENT AND REPAIR OR REPLACEMENT SHALL BE MADE PROMPTLY AS NEEDED.
6. SILT FENCE SHALL BE REMOVED WHEN IT HAS SERVED IS USEFULNESS, SO AS NOT TO BLOCK OR IMPEDE STORM FLOW OR DRAINAGE.
7. SEDIMENT TRAPPED BY THIS PRACTICE SHALL BE DISPOSED OF IN AN APPROVED SITE IN A MANNER THAT WILL NOT CONTRIBUTE TO ADDITIONAL SILTATION.
8. ACCUMULATED SILT SHALL BE REMOVED WHEN IT REACHES A DEPTH OF SIX INCHES AND DISPOSED OF IN AN APPROVED SPOIL SITE OR AS IN No. 7 ABOVE.
9. FILTER FABRIC IS TO BE MIRAFI 100X OR APPROVED EQUAL.
10. CONTRACTOR TO REMOVE SILT FENCE UPON COMPLETION OF PROJECT. DAMAGED AREAS TO BE REPAIRED INCLUDING RE-GRADING AND RE-GRASSING AS NECESSARY.
11. ALL EROSION CONTROL DEVICES AND REQUIREMENTS TO BE IN ACCORDANCE WITH NCTCOG BMP EROSION CONTROL MANUAL AND PLANS AND SPECIFICATIONS.
12. UNLESS APPROVED BY OWNER, EROSION CONTROL FENCING SHALL BE USED IN AREAS WITH NO TREES ONLY.

**Standard Construction Details**

for  
City of Dallas  
Park and Recreation Department

Typical Construction Details  
PAVEMENT &  
PARKING DETAILS

**SILT FENCE  
DETAILS**

issue date

revisions