




scale:
dsnd:
drawn:
approved:

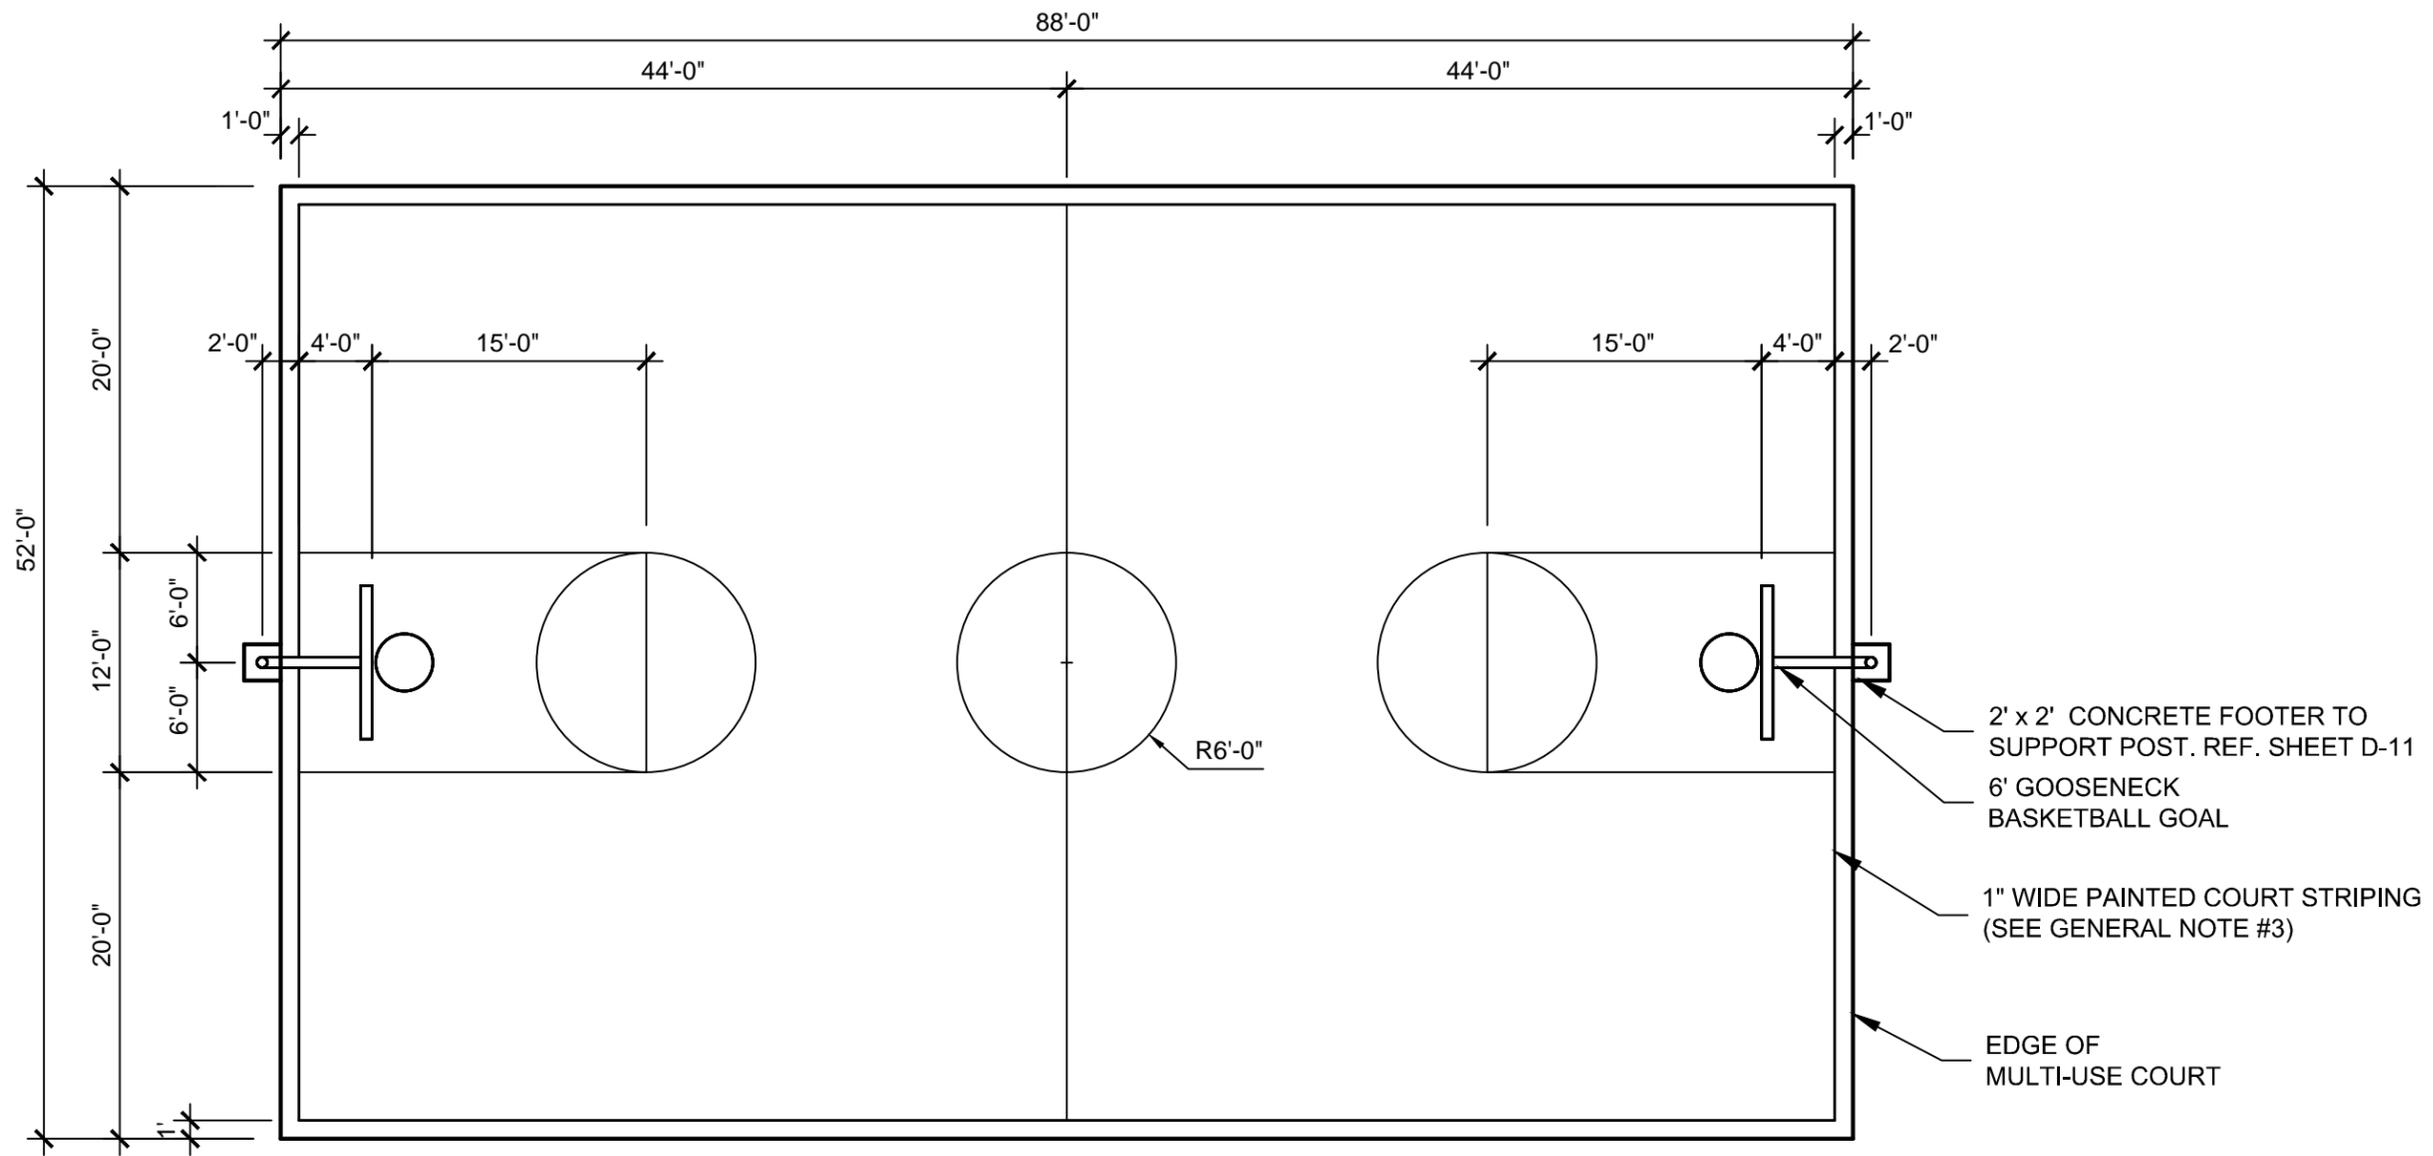

GENERAL NOTES:

1. ALL WRITTEN DIMENSIONS SHALL PREVAIL.
2. BASKETBALL COURT TO BE POST TENSION CONCRETE SLAB.
3. ALL COURT STRIPING TO BE 1" WIDTH PAINTED WHITE OR ALTERNATE COLOR APPROVED BY OWNER.

POST TENSIONING NOTES:

1. POST TENSIONING SHALL MEET ALL CURRENT STANDARDS OF THE POST TENSIONING INSTITUTE.
2. INSTALLATION PROCEDURES, FOR REVIEW PRIOR TO BEGINNING INSTALLATION OF BASKETBALL COURT.
3. ALL TENDONS SHALL BE 1/2" DIAMETER - 270 KSI STRAND.
4. ALL CONCRETE SHALL BE 3600 PSI MINIMUM.
5. AGGREGATE USED IN CONCRETE IS TO BE UNIFORMLY GRADED WITH @ LEAST 500 # 3/8" AGGREGATE PER YARD.
6. PARTIAL STRESSING (25%) SHALL BE REQUIRED @ 24 HOURS. 100% STRESSING SHALL BE COMPLETED WITHIN 7 DAYS. REQUIRED ANCHOR FORCE TO BE 28.9 KPS.
7. SUBMIT CONCRETE MIX DESIGN FOR REVIEW BY PARKS DEPARTMENT REPRESENTATIVE.

D
9 BASKETBALL COURT LAYOUT

SCALE : 1" = 10'-0"

Standard Construction Details

for
City of Dallas
Park and Recreation Department

Typical Construction Details
ATHLETIC FIELD
DETAILS

BASKETBALL
COURT
LAYOUT

issue date

revisions

DETAIL D-9