




scale:  
dsnd:  
drawn:  
approved:

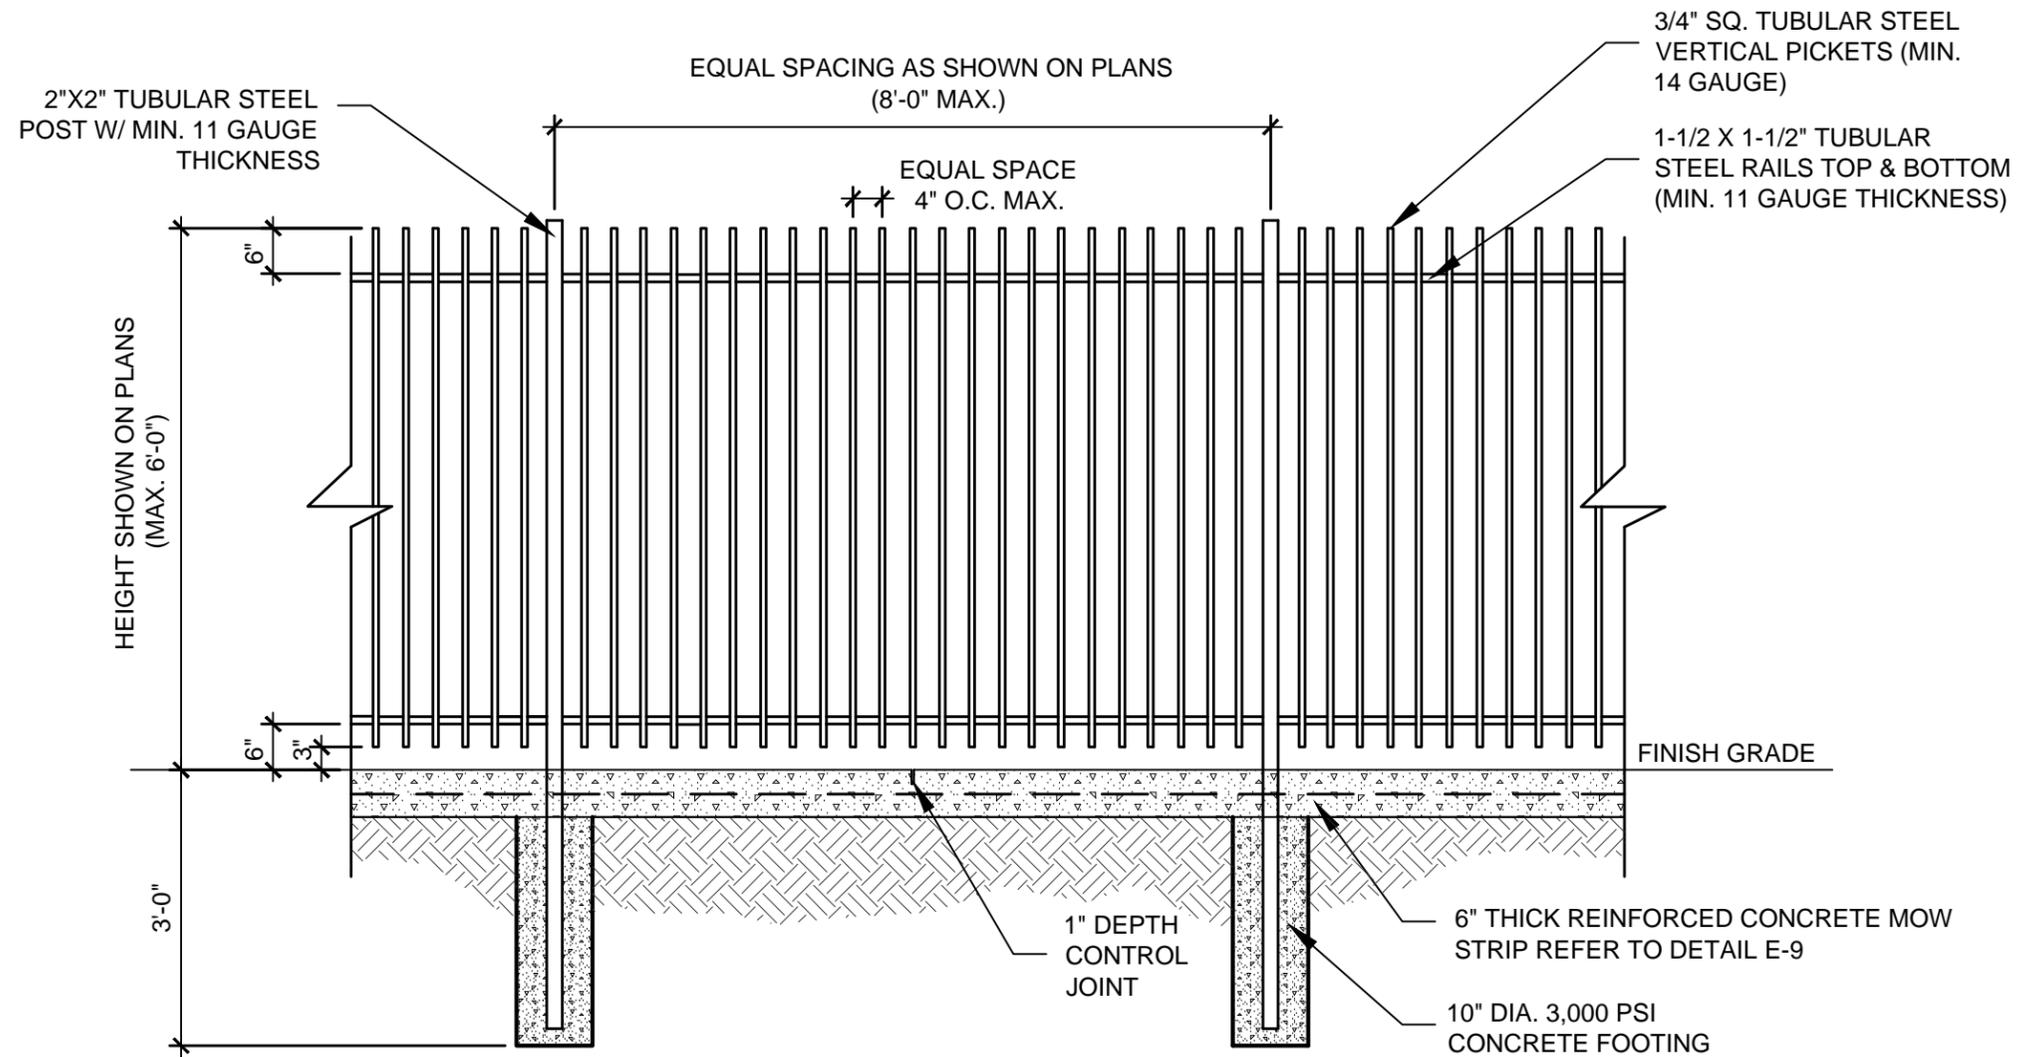

**GENERAL NOTES:**

1. ALL CONCRETE USED IN MOW STRIP SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3600 PSI @ 28 DAYS.
2. 1" DEPTH CONTROL JOINTS SHALL BE INSTALLED PERPENDICULARLY AT BETWEEN POSTS UNLESS NOTED OTHERWISE ALONG ENTIRE LENGTH OF MOW STRIP.
3. ALL TUBULAR STEEL POSTS, RAILS AND PICKETS SHALL BE FLUSH AND FREE OF ALL DENTS, SPURS, AND SHARP EDGES AND SHALL BE INSTALLED LEVEL, PLUMB, AND SQUARE.
4. PROVIDE CONTINUOUS WELDS ALONG ALL EDGES OF FENCE MEMBERS. GRIND SMOOTH ALL WELDS.
5. ALL METAL SURFACES SHALL BE PRIMED AND PAINTED WITH TWO COATS OF RUST-PROOF PAINT, COLOR TO BE FLAT BLACK OR AS SPECIFIED ON PLANS. CONTRACTOR TO SUBMIT SAMPLES AS REQUIRED.
6. CONTRACTOR IS RESPONSIBLE FOR VERIFYING ALL DIMENSIONS BEFORE MANUFACTURING GATES AND FENCE.
7. ALL TUBULAR STEEL FENCE MEMBERS ARE TO BE IN ACCORDANCE WITH ASTM 513 HOT ROLLED STRUCTURAL STEEL 50,000 PSI TENSILE STRENGTH, 60,000 PSI YIELD STRENGTH.
8. CONTRACTOR TO PROVIDE SHOP DRAWINGS FOR ALL FENCE COMPONENTS AND GATES. SHOP DRAWINGS SHALL INCLUDE ALL PRODUCT CUT SHEETS AS WELL AS INSTALLATION AND MANUFACTURING DETAILS. CONTRACTOR TO BE RESPONSIBLE FOR STRUCTURAL DESIGN OF GATES.

**Standard Construction Details**

for  
City of Dallas  
Park and Recreation Department

Typical Construction Details  
HANDRAIL &  
FENCING DETAILS

**TUBULAR  
STEEL  
FENCE DETAIL**

issue date

revisions

**E**  
**8** TUBULAR STEEL FENCE DETAILS

SCALE: 1/2" = 1'-0"

DETAIL E-8